


Cable outlet



ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

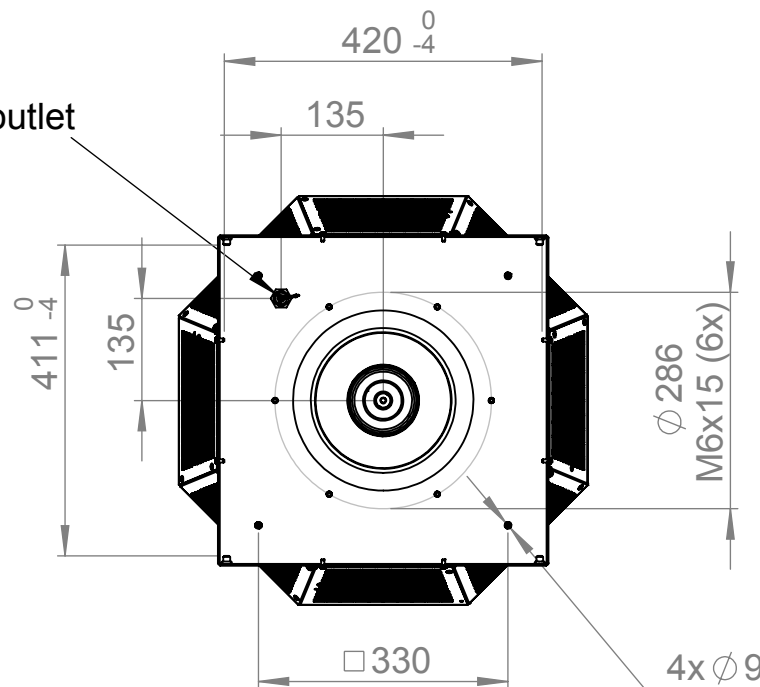

Protection Mark
according to ISO16016

Drawn: a.mezei
Created: s.pop
Changed:

1:10 A4 mm

General tolerances
DIN ISO 2768-mK

DHA280ECP30

131264 00