


Cable outlet



ruck Ventilatoren
Max-Planck-Str. 5
D-97944 Boxberg

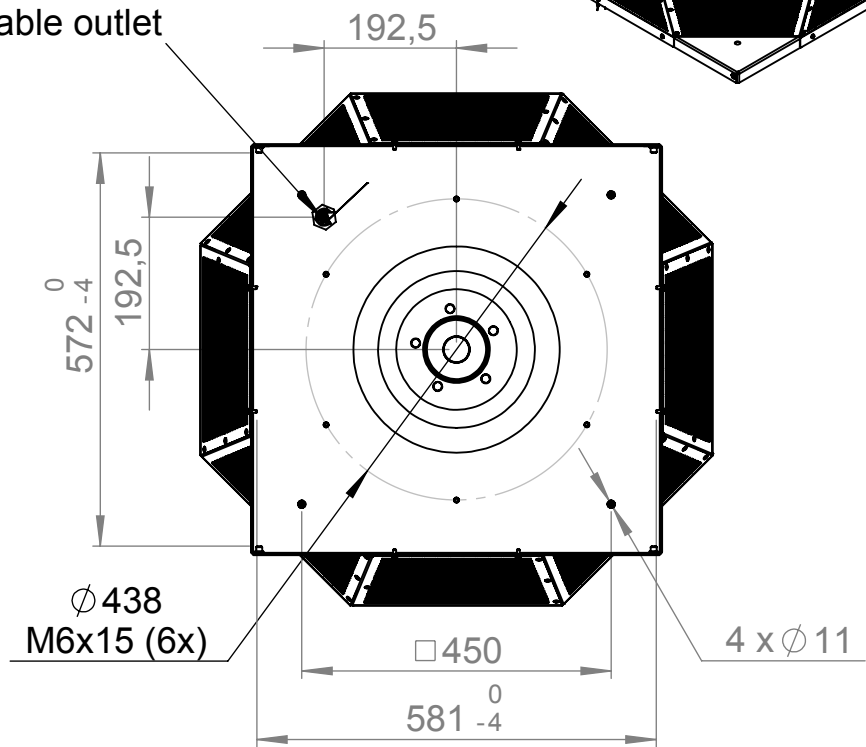

1:9 A4 mm

Protection Mark
according to ISO16016

General tolerances
DIN ISO 2768-mK

DHA355EC30+

Drawn: l.benk
Created: s.pop
Changed:

14.01.15
29.10.14

131237 00